


See NBC(AE)-2023 Table 3.1.17.1 for guidelines on anticipated occupant load.

Does the building require a fire alarm system?

Flowchart derived from NBC(AE)-2023 3.2.4.1

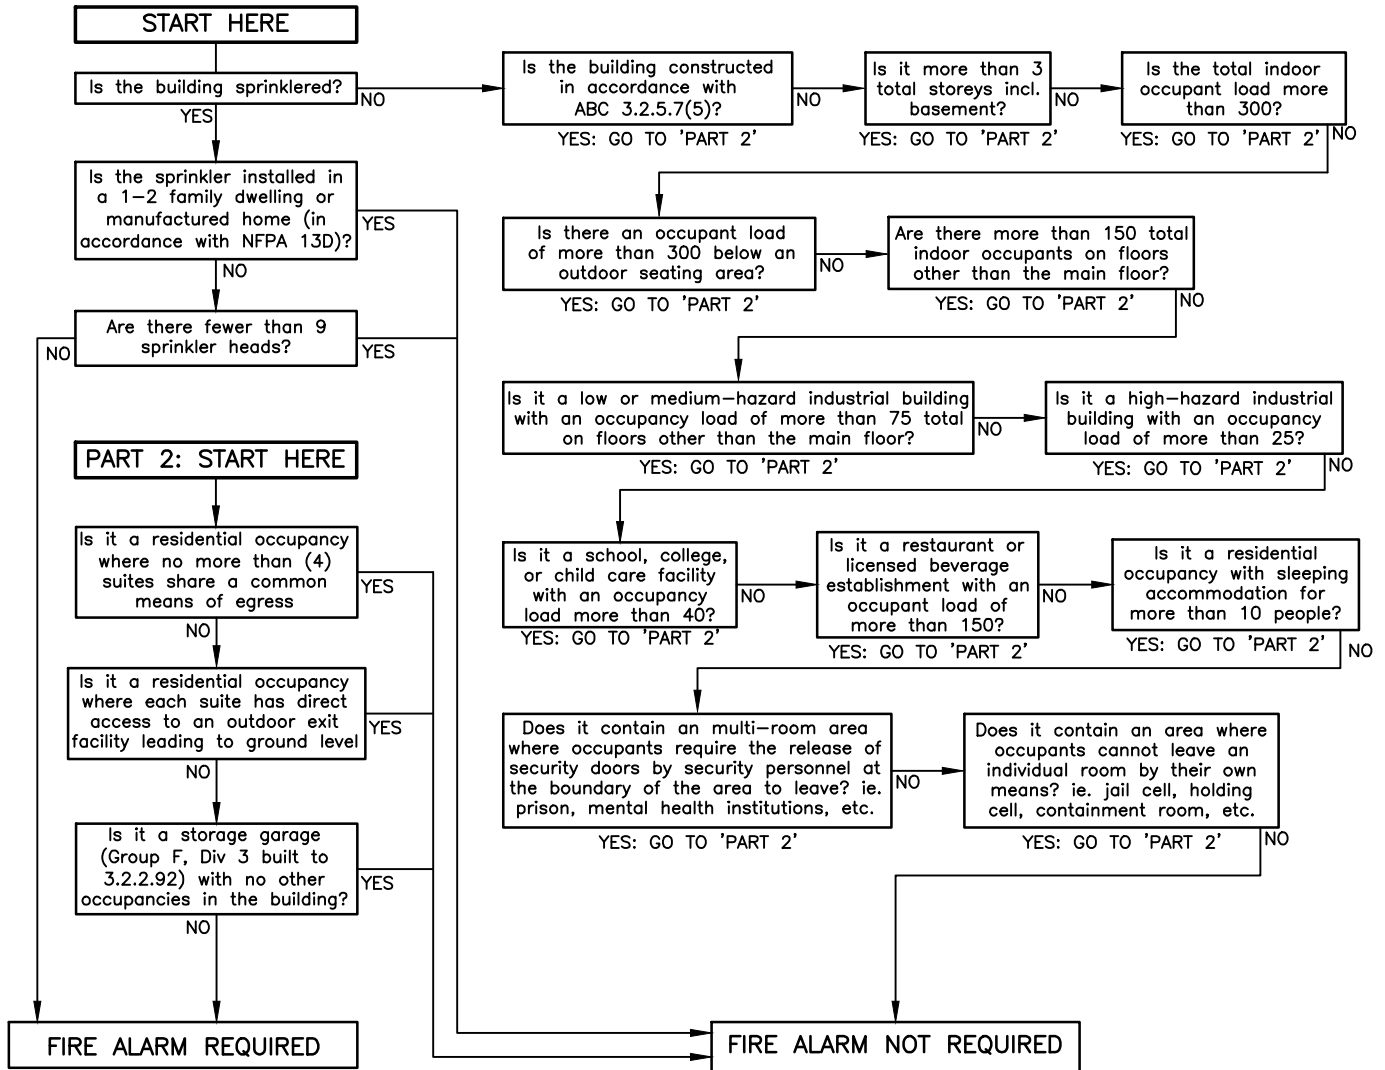

THIS FLOWCHART HAS BEEN PUBLISHED AS PUBLIC SERVICE. IT IS NOT INTENDED TO REPLACE PROFESSIONAL ENGINEERING ADVICE. REFER TO THE ALBERTA BUILDING CODE FOR FURTHER REQUIREMENTS, DETAILS, AND EXCEPTIONS. 908 ENGINEERING ASSUMES NO RESPONSIBILITY FOR THE CONTENT HEREIN.

REV.	DATE	DESCRIPTION
4	22 OCT 2024	UPDATED TO NATIONAL BUILDING CODE - 2023 ALBERTA EDITION
3	23 OCT 2019	UPDATED TO NATIONAL BUILDING CODE - 2019 ALBERTA EDITION
2	03 NOV 2017	UPDATED STANDATA REFERENCE TO ABC(2014)
1	09 OCT 2015	UPDATED ABC(2006) REFERENCES TO ABC(2014)

908 Engineering INCORPORATED

PO Box 20020 Red Deer, AB T4N 6X5
Phone: 403.986.2939 Web: 908eng.com

PROJECT:

FIRE ALARM SYSTEM REQUIREMENTS

FILE NO:

N/A

DWG NO:

FA

1 OF 1

DRAWN: COB

CHECKED: COB

DATE: 22 OCT 24

FIRE ALARM REQUIRED?